
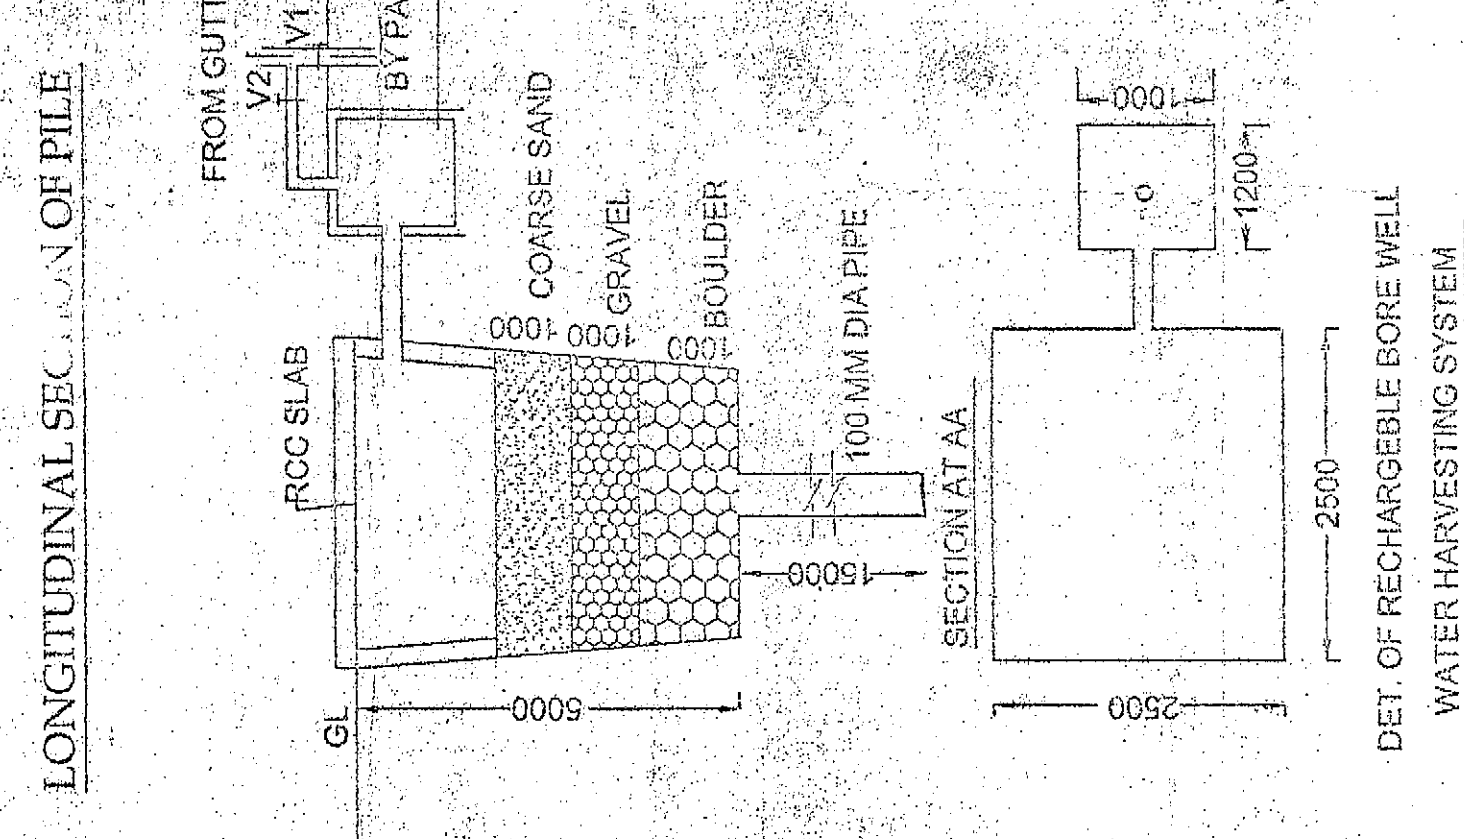
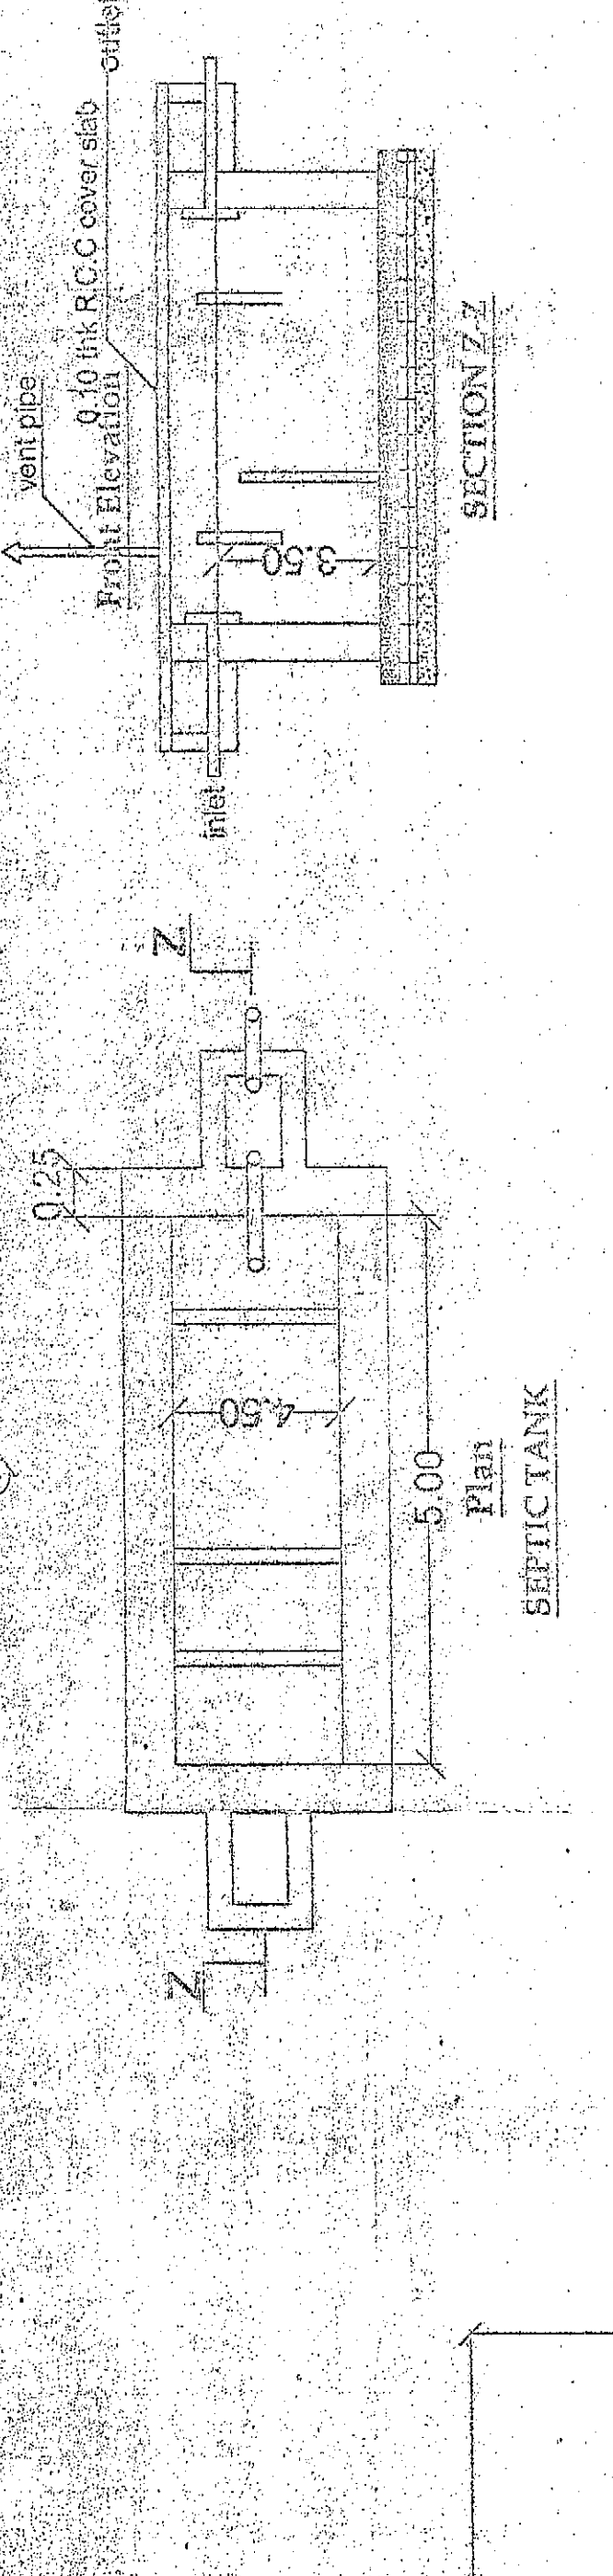
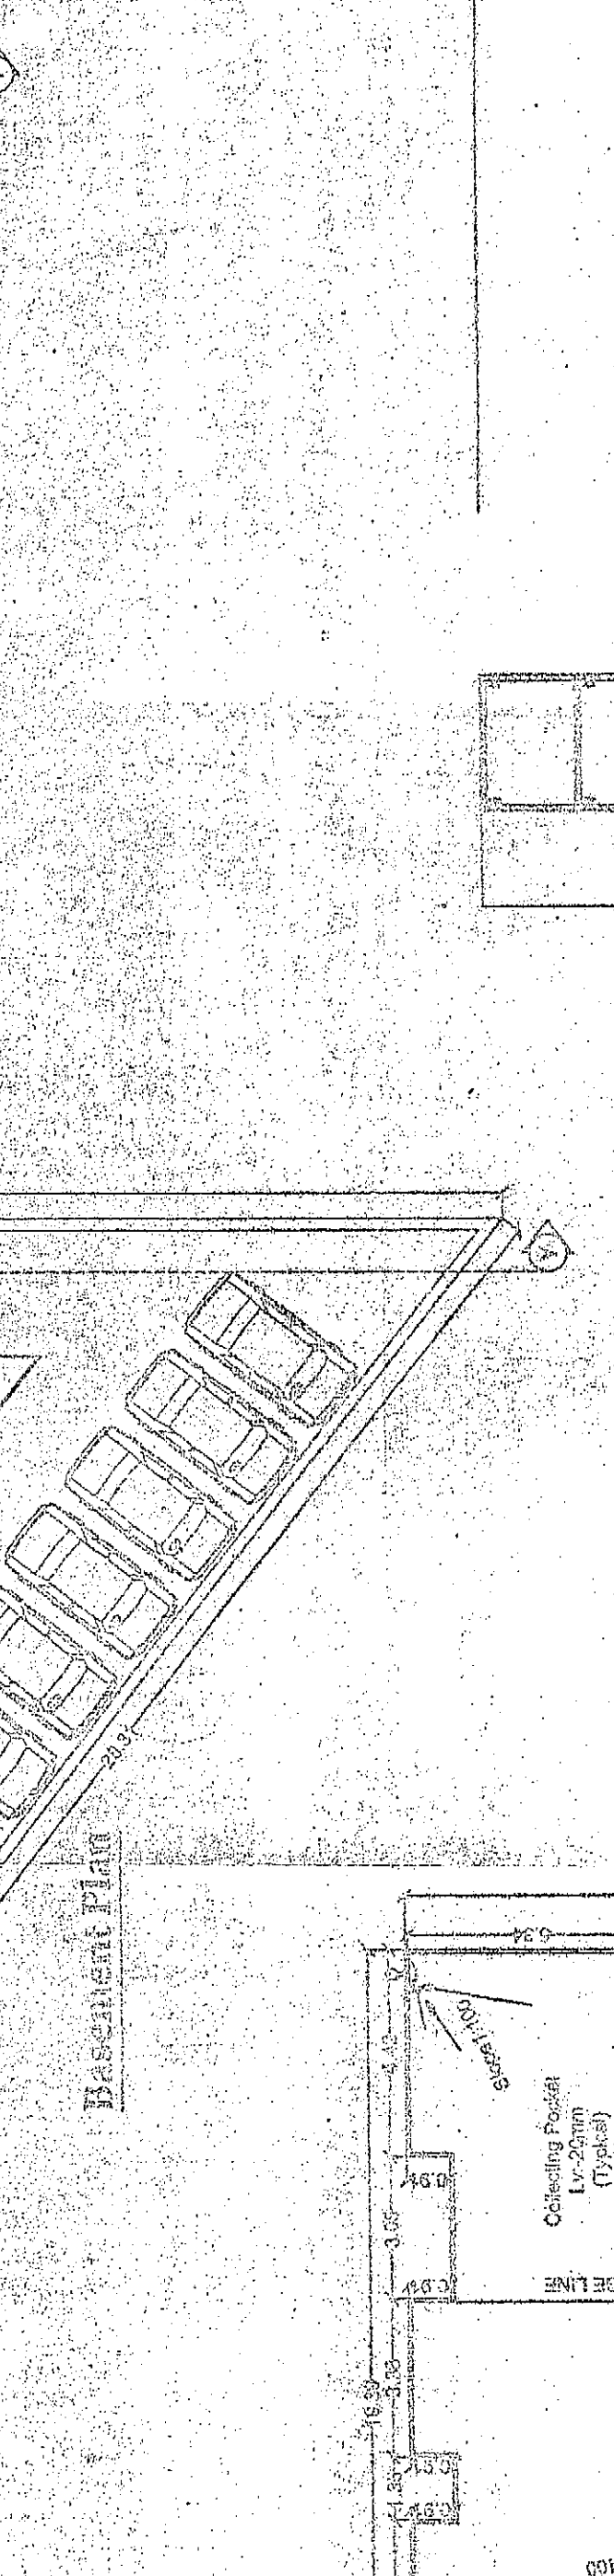


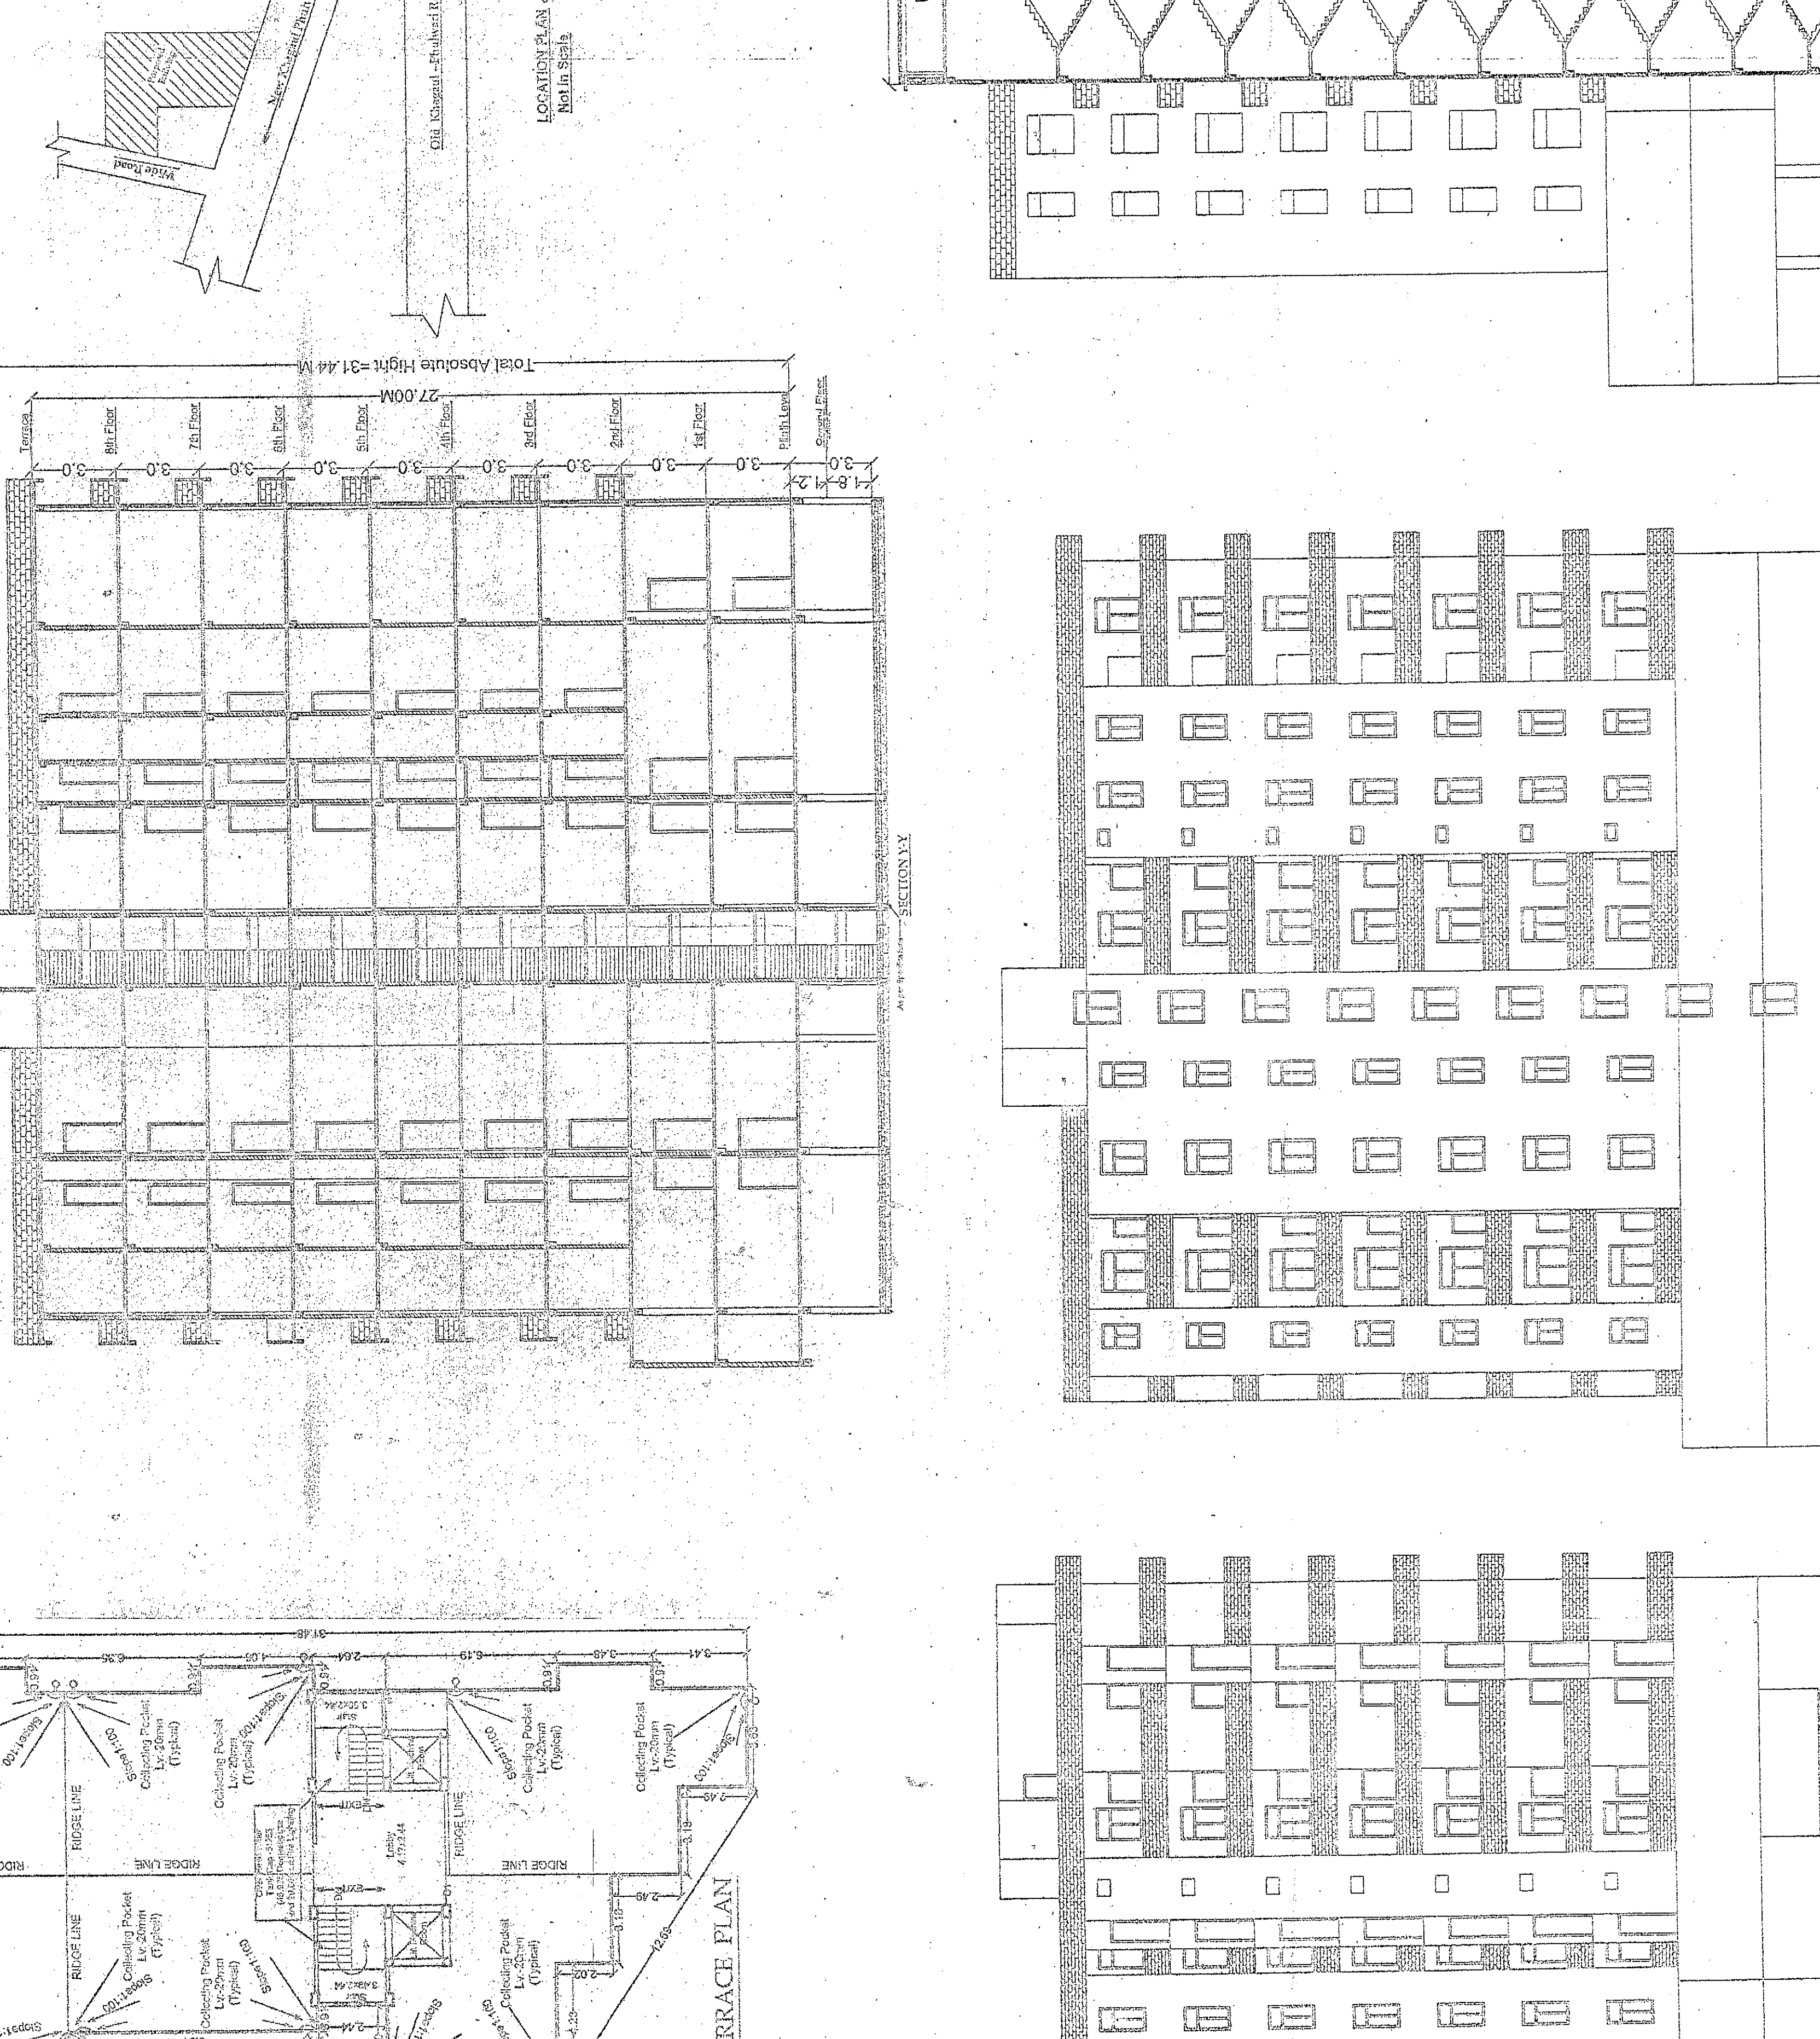

AREA CALCULATION

Total Plot Area (Acres) = Possession - 139.11 Sgm	
Commercial - FIRST FLOOR BUILT UP AREA = 486.14 Sgm.	
Residential - SECOND FLOOR BUILT UP AREA = 486.14 Sgm.	
Residential - THIRD FLOOR BUILT UP AREA = 486.14 Sgm.	
Residential - FOURTH FLOOR BUILT UP AREA = 486.14 Sgm.	
Residential - FIFTH FLOOR BUILT UP AREA = 318.79 Sgm.	
Residential - SIXTH FLOOR BUILT UP AREA = 318.79 Sgm.	
Residential - SEVENTH FLOOR BUILT UP AREA = 318.79 Sgm.	
Residential - EIGHTH FLOOR BUILT UP AREA = 318.79 Sgm.	
Total Built Up Area = 4126.57 Sgm	
2nd Floor Balcony Area (In Subseq.) = 45.61 Sgm	
3rd Floor Balcony Area (In Subseq.) = 45.61 Sgm	
4th Floor Balcony Area (In Subseq.) = 45.61 Sgm	
5th Floor Balcony Area (In Subseq.) = 45.61 Sgm	
6th Floor Balcony Area (In Subseq.) = 45.61 Sgm	
7th Floor Balcony Area (In Subseq.) = 45.61 Sgm	
8th Floor Balcony Area (In Subseq.) = 45.61 Sgm	
Balcony Area (In Subseq.) = 359.33 + 359.33 + 359.33 + 359.33 + 359.33 + 359.33 + 359.33 + 359.33 = 2874.64 Sgm.	
Sq. Total Built up Area = 4126.57 Sgm + 2874.64 Sgm = 7001.21 Sgm.	

FIRE EXTINGUISHER

⑤ SPRINKLES (AS PER DESIGN)

ON WATER TANK CAPACITY FOR FIRE = 20000 LIT

ON WATER TANK CAPACITY FOR FIRE = 50000 LIT

MANUAL CALL POINT

EMERGENCY LUC

FIRE EXTINGUISHER

20,000 LIT overhead water tank

AREA COVERED WITH AUTOMATIC HEAD SMOKE DETECTORS

HOSE REEL

FIRE HYDRANT

ALARM SYSTEM

SEWAGE CONNECTION

AREA COVERED WITH AUTOMATIC HEAD SMOKE DETECTORS

STRUCTURE OF ENGINEERING SIGNATURE OF STRUCTURAL ENGINEERING