

Letter No. 4.2.1.7.... /

OFFICE OF THE STATE FIRE SERVICE HQTR, BIHAR, PATNA.

From,

Upendra Prasad Singh,
State Fire Officer,
Bihar, Patna.

To,

Ar. Manoj Kumar,
202-B, Gharaunda Complex,
Jagdeo Path More, Patna-14.

Patna Dt. 30/11/2017

Sub :-

The views regarding proposed fully residential building of above 15 mtr. in height to be constructed at Mauza- Phulwarisharif, Distt.-Patna.

Sir,

Please refer to your letter no.- MKA/NPPH/2017-18/09 Dt. - 03/11/2017, through which this aforesaid plan has been sent to us for examination, which was examined by the Fire Service committee.

During examination of the plan it was found that a three blocks, Block A- G+2, Block B- G+6 & Block C- B+G+6 (Total B/U area-9107.81 Sqmtr.), fully residential building, shall be constructed on 40 feet wide road belongs to Mohini Construction, Partner- Sri Neeraj Kumar, S/O- Sri Mohan Prasad & others, on having Plot no.-1170,1171 & 1172, Khata no.-231,288 & 283, Tauzi no.-5166, Thana no.-35 at Mauza - Phulwarisharif, Dist- Patna.

We clear the plan after giving following advice/suggestions/ recommendations based on NBC guideline, local building by laws & the local circumstances which must be followed by the concerned Architect / Developer/ Land owner as the case may be.

i) Construction :

- a) The whole construction of the proposed building shall be carried out as per approved plan drawing conforming the relevant building rules of local Municipal Corporation as per Building Bye laws Bihar, 2014.
- b) The floor area exceeds 750 m² shall be suitably compartmented by separation walls up to ceiling level having at least two hours Fire resisting capacity.
- c) The interior finish decoration of the building shall be made low flame spread materials conforming I.S. specifications.
- d) Provision of ventilation at the crown of the central core-duct of the building shall be provided.
- e) Arrangements shall have to be made for sealing all the vertical ducts by the materials of adequate Fire resisting capacity.

ii) Open Space & Approach :

- a) The open space surrounding the building shall conform the relevant building rules as well as permit the accessibility and maneuverability of Fire appliance with turning facility 3.60 m/s (minimum). This rule is applicable only for building above 15 meter height.
- b) The approach roads shall be sufficiently strong to withstand the load of Fire Engine weighting up to 20 M.T.
- c) The width and height of the access gates into the premises shall not be less than 4.5 M and 5M respecting abutting the road.

iii) Stair Case :-

- a) The Staircase of the building shall be enclosed type. Entire construction shall be made of brick / R.C.C. type having Fire resisting capacity not less than 4 hours respectively marked in the plan.
- b) The Staircase of the building shall have permanent vents at the top equal to 5% of the cross sectional area of the staircase enclosures and openable sashes at each floor level equal to 15% of the said cross section are shall have to be provided in the external wall of the building.
- c) All the Staircase of the building shall be negotiable to each other in each floor without entering into any room and shall be extended up to respective terrace. The roof of the Stair wall shall be 1M above the surrounding roof area.
- d) The width of the Staircases and corridor and travel distance of different categories of occupancies shall have to conform the relevant building rules.
- e) In case of two staircase, one must be on outer wall.
- f) Both staircase are not went down to basement floor. for approach to basement, there should be another staircase for approach.

iv) LIFT :-

- a) The walls of the Lift enclosure of the building shall be at least two hours Fire resisting type respectively marked in the plan with the event at top of area not less than 0.2 m^2 .
- b) The lift of the building shall be designed at high speed "Fire Lift" and conspicuously indicated marked in the plan.
- c) In case of failure of normal electric supply, it shall automatically trip over to alternate supply. For apartment houses these change over of supply could be done through manually operated change over switch. Alternatively, the lift shall be so wired that in case of power failure, it comes down at the ground level and comes to stand still with door open.
- d) Arrangement shall be provided for extraction of smoke in all the lift shaft by incorporation smoke venting system designed to permit 30 Air changes per hour in case of Fire and shall be of such design as to operate on actuation of sprinkler or Fire Alarm. In case of failure of normal electric supply. It shall automatically trip to alternate supply.
- e) All other requirements shall conform the I.S. specification including the communication facility in the lift cars connecting with the Fire Control Room of the building.
- v) That the basement should be equipped with automatic sprinkler's installation & must have two separate exits.
- vi) That active Fire protection system such as down comer system with landing valve and hose reel at each floor incorporated with 900 LPM pump each blocks provided at Terrace level, ISI marked Fire extinguishers as per I.S 2190/1992 & relevant specification, F.R. check door, manual call alarm point, Fire safety luminescent sign & other Fire precautionary measures as mentioned in NBC be provided before occupancy.
- vii) That an underground water static tank of not less than 50,000 Ltrs. capacity with automatic refilling arrangements preferably on front side where Fire Brigade vehicles can reach easily & overhead water static tank of not less than 10,000 Ltrs. Capacity each blocks should be made available before occupancy.
- viii) That there should be a clear passage of 3.66 Mtr. or above, all around of the both blocks of the building with a clear height of 5 Mts to facilitate the movement of Fire vehicles at the time of emergency.
- ix) That the internal finishing shall be non-combustible or class - I surface spread of flame.
- x) That electric cables must be shield at each floor with intumescent coating.
- xi) That Fire exit drill be carried out regularly at least twice in a year after occupation.
- xii) That the building must be constructed on at least 40 feet wide road and it is responsibility of the concerned Architect to be ensure the road width because he is the passing authority.
- xiii) That AMC should be given to a qualified firm or person for the maintenance of above recommended Fire equipments.
- xiv) That the setback shall be checked by the Architect / Passing authority as per the established rule. If any thing wrong, the Architect / Passing authority shall be held responsible.
- xv) It is hereby made clear that in case of any legal dispute arising in future, in which above recommendations have not been complied, the responsibility will fall entirely upon the Developers/ Architect/ Landowner as the case may be and not on the recommending Govt. authority (i.e. the office of the State Fire Office, Bihar).
- xvi) It is hereby made also clear that this office (i.e. the office of the State Fire Officer-cum-Director, Bihar, Patna) is not responsible for any legal dispute of the land upon which the proposed building shall be constructed.
- xvii) The building and for making adequate provisions for services and equipment for protection from the fire hazards as per the stipulations of the National Building Code of India in the buildings and shall obtain N.O.C. from the Chief Fire Officer or concerned Authority/ before applying for occupation certificate.


This shall be treated as provisional. On compliance of all the above Fire and Life Safety recommendations, this office shall be approached for necessary inspection and testing of the installation, Final in favor of the occupancy shall be issued on being satisfied with the tests and performances of safety aspects of installation of the building.

N.B. - Any deviation and changes the nature of use of the building in respect of the approved plan drawing without obtaining prior permission from this office, this provisional will be treated as cancelled.

The maps are being returned with sign and stamp.

Encl - As Above

Yours faithfully,


(Upendra Prasad Singh)

...of the building following the recommendations of NBC guidelines...
...which shall be followed by the concerned Architect / Developer / Landowner as the case may be

CONSTRUCTION :

- a) The whole construction of the proposed building shall be carried out as per approved plan drawing conforming the relevant building rules of local Municipal Corporation as per Building Bye laws Bihar, 2014
- b) The floor area exceeds 750 m² shall be suitably compartmented by separation walls up to ceiling level having at least two hours Fire resisting capacity.
- c) The interior finish decoration of the building shall be made low flame spread materials conforming I.S. specifications
- d) Provision of ventilation at the crown of the central core-duct of the building shall be provided.
- e) Arrangements shall have to be made for sealing all the vertical ducts by the materials of adequate Fire resisting capacity

ii) Open Space & Approach :


- a) The open space surrounding the building shall conform the relevant building rules as well as permit the accessibility and maneuverability of Fire appliance with turning facility 3.60 m/s (minimum). This rule is applicable only for building above 15 meter height.
- b) The approach roads shall be sufficiently strong to withstand the load of Fire Engine weighting up to 20 M.T.
- c) The width and height of the access gates into the premises shall not be less than 4.5 M and 5M respecting abutting the road.

iii) Stair Case :-

- a) The Staircase of the building shall be enclosed type. Entire construction shall be made of brick / R.C.C. type having Fire resisting capacity not less than 4 hours respectively marked in the plan.
- b) The Staircase of the building shall have permanent vents at the top equal to 5% of the cross sectional area of the staircase enclosures and openable sashes at each floor level equal to 15% of the said cross section are shall have to be provided in the external wall of the building.
- c) All the Staircase of the building shall be negotiable to each other in each floor without entering into any room and shall be extended up to respective terrace. The roof of the Stair wall shall be 1M above the surrounding roof area.
- d) The width of the Staircases and corridor and travel distance of different categories of occupancies shall have to conform the relevant building rules.
- e) In case of two staircase, one must be on outer wall.
- f) Both staircase are not went down to basement floor, for approach to basement, there should be another staircase for approach.

iv) LIFT :-

- a) The walls of the Lift enclosure of the building shall be at least two hours Fire resisting type respectively marked in the plan with the event at top of area not less than 0.2 m².
- b) The lift of the building shall be designed at high speed "Fire Lift" and conspicuously indicated marked in the plan.
- c) In case of failure of normal electric supply, it shall automatically trip over to alternate supply. For apartment houses these change over of supply could be done through manually operated change over switch. Alternatively, the lift shall be so wired that in case of power failure, it comes down at the ground level and comes to stand still with door open.
- d) Arrangement shall be provided for extraction of smoke in all the lift shaft by incorporation smoke venting system designed to permit 30 Air changes per hour in case of Fire and shall be of such design as to operate on actuation of sprinkler or Fire Alarm. In case of failure of normal electric supply. It shall automatically trip to alternate supply.
- e) All other requirements shall conform the I.S. specification including the communication facility in the lift cars connecting with the Fire Control Room of the building.
- v) That the basement should be equipped with automatic sprinkler's installation & must have two separate exits.
- vi) That active Fire protection system such as down comer system with landing valve and hose reel at each floor incorporated with 900 LPM pump each blocks provided at Terrace level, ISI marked Fire extinguishers as per I.S 2190/1992 & relevant specification, F.R. check door, manual call alarm point, Fire safety luminescent sign & other Fire precautionary measures as mentioned in NBC be provided before occupancy.
- vii) That an underground water static tank of not less than 50,000 Ltrs. capacity with automatic refilling arrangements preferably on front side where Fire Brigade vehicles can reach easily & overhead water static tank of not less than 10,000 Ltrs. Capacity each blocks should be made available before occupancy.
- viii) That there should be a clear passage of 3.66 Mtr. or above, all around of the both blocks of the building with a clear height of 5 Mts to facilitate the movement of Fire vehicles at the time of emergency.
- ix) That the internal finishing shall be non-combustible or class - I surface spread of flame.
- x) That electric cables must be shield at each floor with intumescent coating.
- xi) That Fire exit drill be carried out regularly at least twice in a year after occupation.
- xii) That the building must be constructed on at least 40 feet wide road and it is responsibility of the concerned Architect to be ensure the road width because he is the passing authority.
- xiii) That AMC should be given to a qualified firm or person for the maintenance of above recommended Fire equipments.
- xiv) That the setback shall be checked by the Architect / Passing authority as per the established rule. If any thing wrong, the Architect / Passing authority shall be held responsible.
- xv) It is hereby made clear that in case of any legal dispute arising in future, in which above recommendations have not been complied, the responsibility will fall entirely upon the Developers/ Architect/ Landowner as the case may be and not on the recommending Govt. authority (i.e. the office of the State Fire Office, Bihar).
- xvi) It is hereby made also clear that this office (i.e. the office of the State Fire Officer-cum-Director, Bihar, Patna) is not responsible for any legal dispute of the land upon which the proposed building shall be constructed.
- xvii) The building and for making adequate provisions for services and equipment for protection from the fire hazards as per the stipulations of the National Building Code of India in the buildings and shall obtain N.O.C. from the Chief Fire Officer or concerned Authority/ before applying for occupation certificate.


State Fire Officer
B.H. O. Patna

12/29/2017

Gmail - ऊंचाई मंजूरी के लिए अनापत्ति प्रमाण पत्र/NOC FOR HEIGHT CLEARANCE (NOCAS ID: PATN_EAST_B_121917_268806)

Mohini Constructions <post.mohini@gmail.com>

ऊंचाई मंजूरी के लिए अनापत्ति प्रमाण पत्र/NOC FOR HEIGHT CLEARANCE (NOCAS ID: PATN_EAST_B_121917_268806)

1 message

vecc.noc <vecc.noc@aai.aero>

To: "post.mohini@gmail.com" <post.mohini@gmail.com>

Cc: Airport Director Patna <apdpatna@aai.aero>, "GM(ATM) ER" <gmatmer@aai.aero>

Fri, Dec 29, 2017 at 5:01 PM

महोदय/Sir,

ऊपर उल्लेख NOCAS आईडी के संबंध में अनापत्ति प्रमाण पत्र संलग्न है ।

Attached please find the NOC letter with respect to above mentioned NOCAS ID.

सस्नेह/With Regards,

सुजीत सेन/Sujit Sen

सं.म.प्र(एटीएम) - एनओसी/Jt.GM(ATM)-NOC

कृते महा प्रबन्धक (एटीएम)

For General Manager (ATM),ER

Disclaimer

The information contained in this electronic message and in any attachments to this message is confidential, legally privileged and intended only for the person or entity to which this electronic message is addressed. If you are not the intended recipient, please notify the system manager and you are hereby notified that any distribution, copying, review, re-transmission, dissemination or other use of this electronic transmission or the information contained in it is strictly prohibited. Please also note that any views or opinions presented in this email are solely those of the author and may not represent those of the Organization or bind the Organization. This message has been scanned for viruses and dangerous content by Mail Scanner, and is believed to be clean. Airports Authority of India accepts no liability for any damage caused by any virus transmitted by this email.

→ PATN_EAST_B_121917_268806(SIGNED).pdf
1524K

Mohini Constructions

Neeraj Kumar
Partner



भारतीय विमानपत्तन प्राधिकरण
AIRPORTS AUTHORITY OF INDIA

Neeraj Kumar

Mithilesh Sadan, sarvudaya nagar
C.D.A. COLONY . NORTH L.B.S.
Nagar Patna Bihar 800001

Date: 28-12-2017

Valid Upto: 27-12-2025

No Objection Certificate for Height Clearance

1. This NOC is issued by Airports Authority of India (AAI) in pursuance of responsibility conferred by and as per the provisions of Govt. of India (Ministry of Civil Aviation) order GSR751 (E) dated 30th Sep. 2015 for Safe and Regular Aircraft Operations.

2. This office has no objection to the construction of the proposed structure as per the following details:

NOC ID :	PATN/EAST/B/121917/268806
Applicant Name*	Neeraj Kumar
Site Address*	plot no- 1170 , 1171, 1172 , Thana no.- 35,Ranipur road/phulwari sharif/ patna,Patna,Bihar
Site Coordinates*	85 04 36.61-25 34 26.09, 85 04 36.68-25 34 26.48, 85 04 37.46-25 34 26.42, 85 04 38.16-25 34 26.03,
Site Elevation in mtrs AMSL as submitted by Applicant*	54 M
Permissible Top Elevation in mtrs Above Mean Sea Level(AMSL)	84M

*As provided by applicant

3. This NOC is subject to the terms and conditions as given below:

a. Permissible Top elevation has been issued on the basis of Site coordinates and Site Elevation submitted by Applicant. AAI neither owns the responsibility nor authenticates the correctness of the site coordinates & site elevation provided by the applicant. If at any stage it is established that the actual data is different, this NOC will stand null and void and action will be taken as per law. The office in-charge of the concerned aerodrome may initiate action under the Aircraft (Demolition of Obstruction caused by Buildings and Trees etc.) Rules, 1994"

b. The Structure height (including any superstructure) shall be calculated by subtracting the Site elevation in AMSL from the Permissible Top Elevation in AMSL i.e. Maximum Structure Height = Permissible Top Elevation minus (-) Site Elevation.

c. The issue of the 'NOC' is further subject to the provisions of Section 9-A of the Indian Aircraft Act, 1934 and any notifications issued there under from time to time including the Aircraft (Demolition of Obstruction caused by Buildings and Trees etc.) Rules, 1994.

क्षेत्रीय मुख्यालय पूर्वी क्षेत्र, नेताजी सुभाष चन्द्र बोस अंतराष्ट्रीय हवाई अड्डा -700052 दूरभाष संख्या: 91-33-2511 9 616

Regional headquarter Eastern Region, Netaji Subhash Chandra Bose International Airport -700052, Tel: 91-33-25119616

Neeraj Kumar



भारतीय विमानपत्तन प्राधिकरण AIRPORTS AUTHORITY OF INDIA

- d. No radio/TV Antenna, lighting arresters, staircase, Mumtee, Overhead water tank and attachments of fixtures of any kind shall project above the Permissible Top Elevation of 84M, as indicated in para 2.
- e. Only use of oil fired or electric fired furnace is permissible, within 8 KM of the Aerodrome Reference Point.
- f. The certificate is valid for a period of 8 years from the date of its issue. One time revalidation without assessment may be allowed, provided construction work has commenced, subject to the condition that such request shall be made within the validity period of the NOC and the delay is due to circumstances which are beyond the control of the developer.
- g. No light or a combination of lights which by reason of its intensity, configuration or colour may cause confusion with the aeronautical ground lights of the Airport shall be installed at the site at any time, during or after the construction of the building. No activity shall be allowed which may affect the safe operations of flights
- h. The applicant will not complain/claim compensation against aircraft noise, vibrations, damages etc. caused by aircraft operations at or in the vicinity of the airport.
- i. Day markings & night lighting with secondary power supply shall be provided as per the guidelines specified in chapter 6 and appendix 6 of Civil Aviation Requirement Series 'B' Part I Section 4. available on DGCA India website: www.dgca.nic.in
- j. The applicant is responsible to obtain all other statutory clearances from the concerned authorities including the approval of building plans. This NOC for height clearances is to ensure the safe and regular aircraft operations and shall not be used as document for any other purpose/claim whatsoever, including ownership of land etc.
- k. This NOC has been issued w.r.t. the Civil Airports. Applicant needs to seek separate NOC from Defence, if the site lies within their jurisdiction.
- l. In case of any discrepancy/interpretation of NOC letter, English version shall be valid.
- m. In case of any dispute w.r.t site elevation and/or AGL height, top elevation in AMSL shall prevail.

Chairman NOC Committee

Region Name: EAST

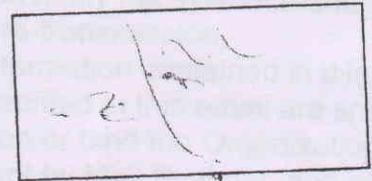
Address: General Manager Airports
Authority of India, Regional
Headquarter, Eastern Region,
N.S.C.B.I Airport,
Kolkata-700052

Email ID: gmatmer@aai.aero

Contact No: 033-25111293

Mohini Constructions

Mheeraj Kumar
Partner



महा प्रबंधक (वायना) पू.क.
General Manager (ATM)ER
भा. वि. प्रा. / A.A.I.
ने.स.च.बो.अ. हवाई अड्डा/N.S.C.B.I. Airport
कोलकाता / Kolkata 700052

क्षेत्रीय मुख्यालय पूर्वी क्षेत्र, नेताजी सुभाष चन्द्र बोस अंतराष्ट्रीय हवाई अड्डा - 700052 दूरभाष संख्या: 91-33-2511 9 616

Regional Headquarter Eastern Region, Netaji Subhash Chandra Bose International Airport - 700052, Tel: 91-33-25119616