
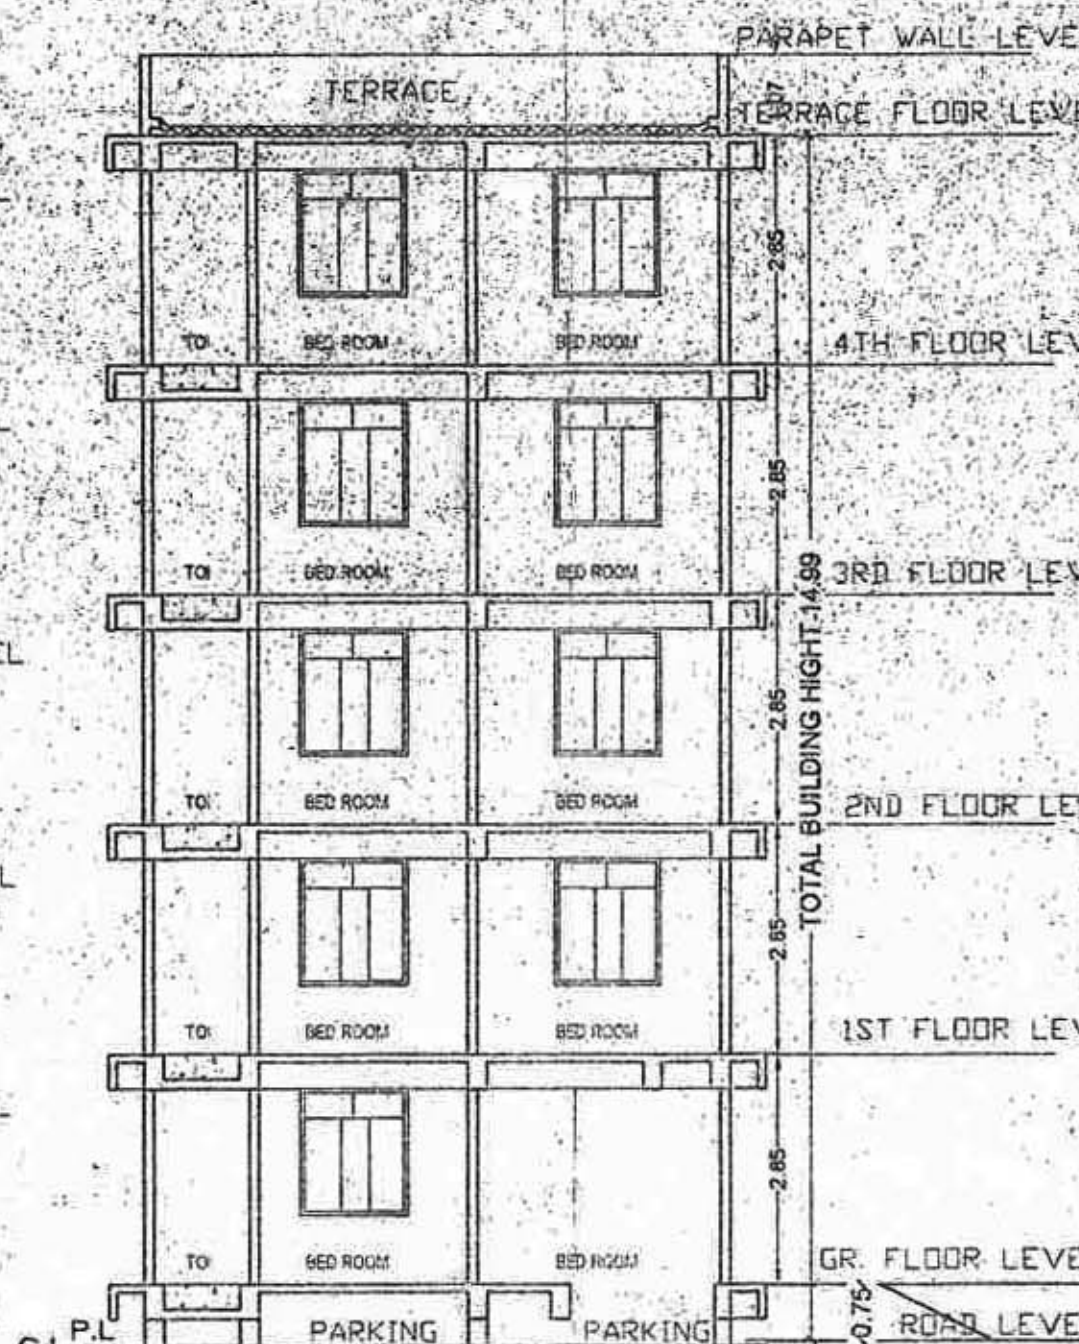


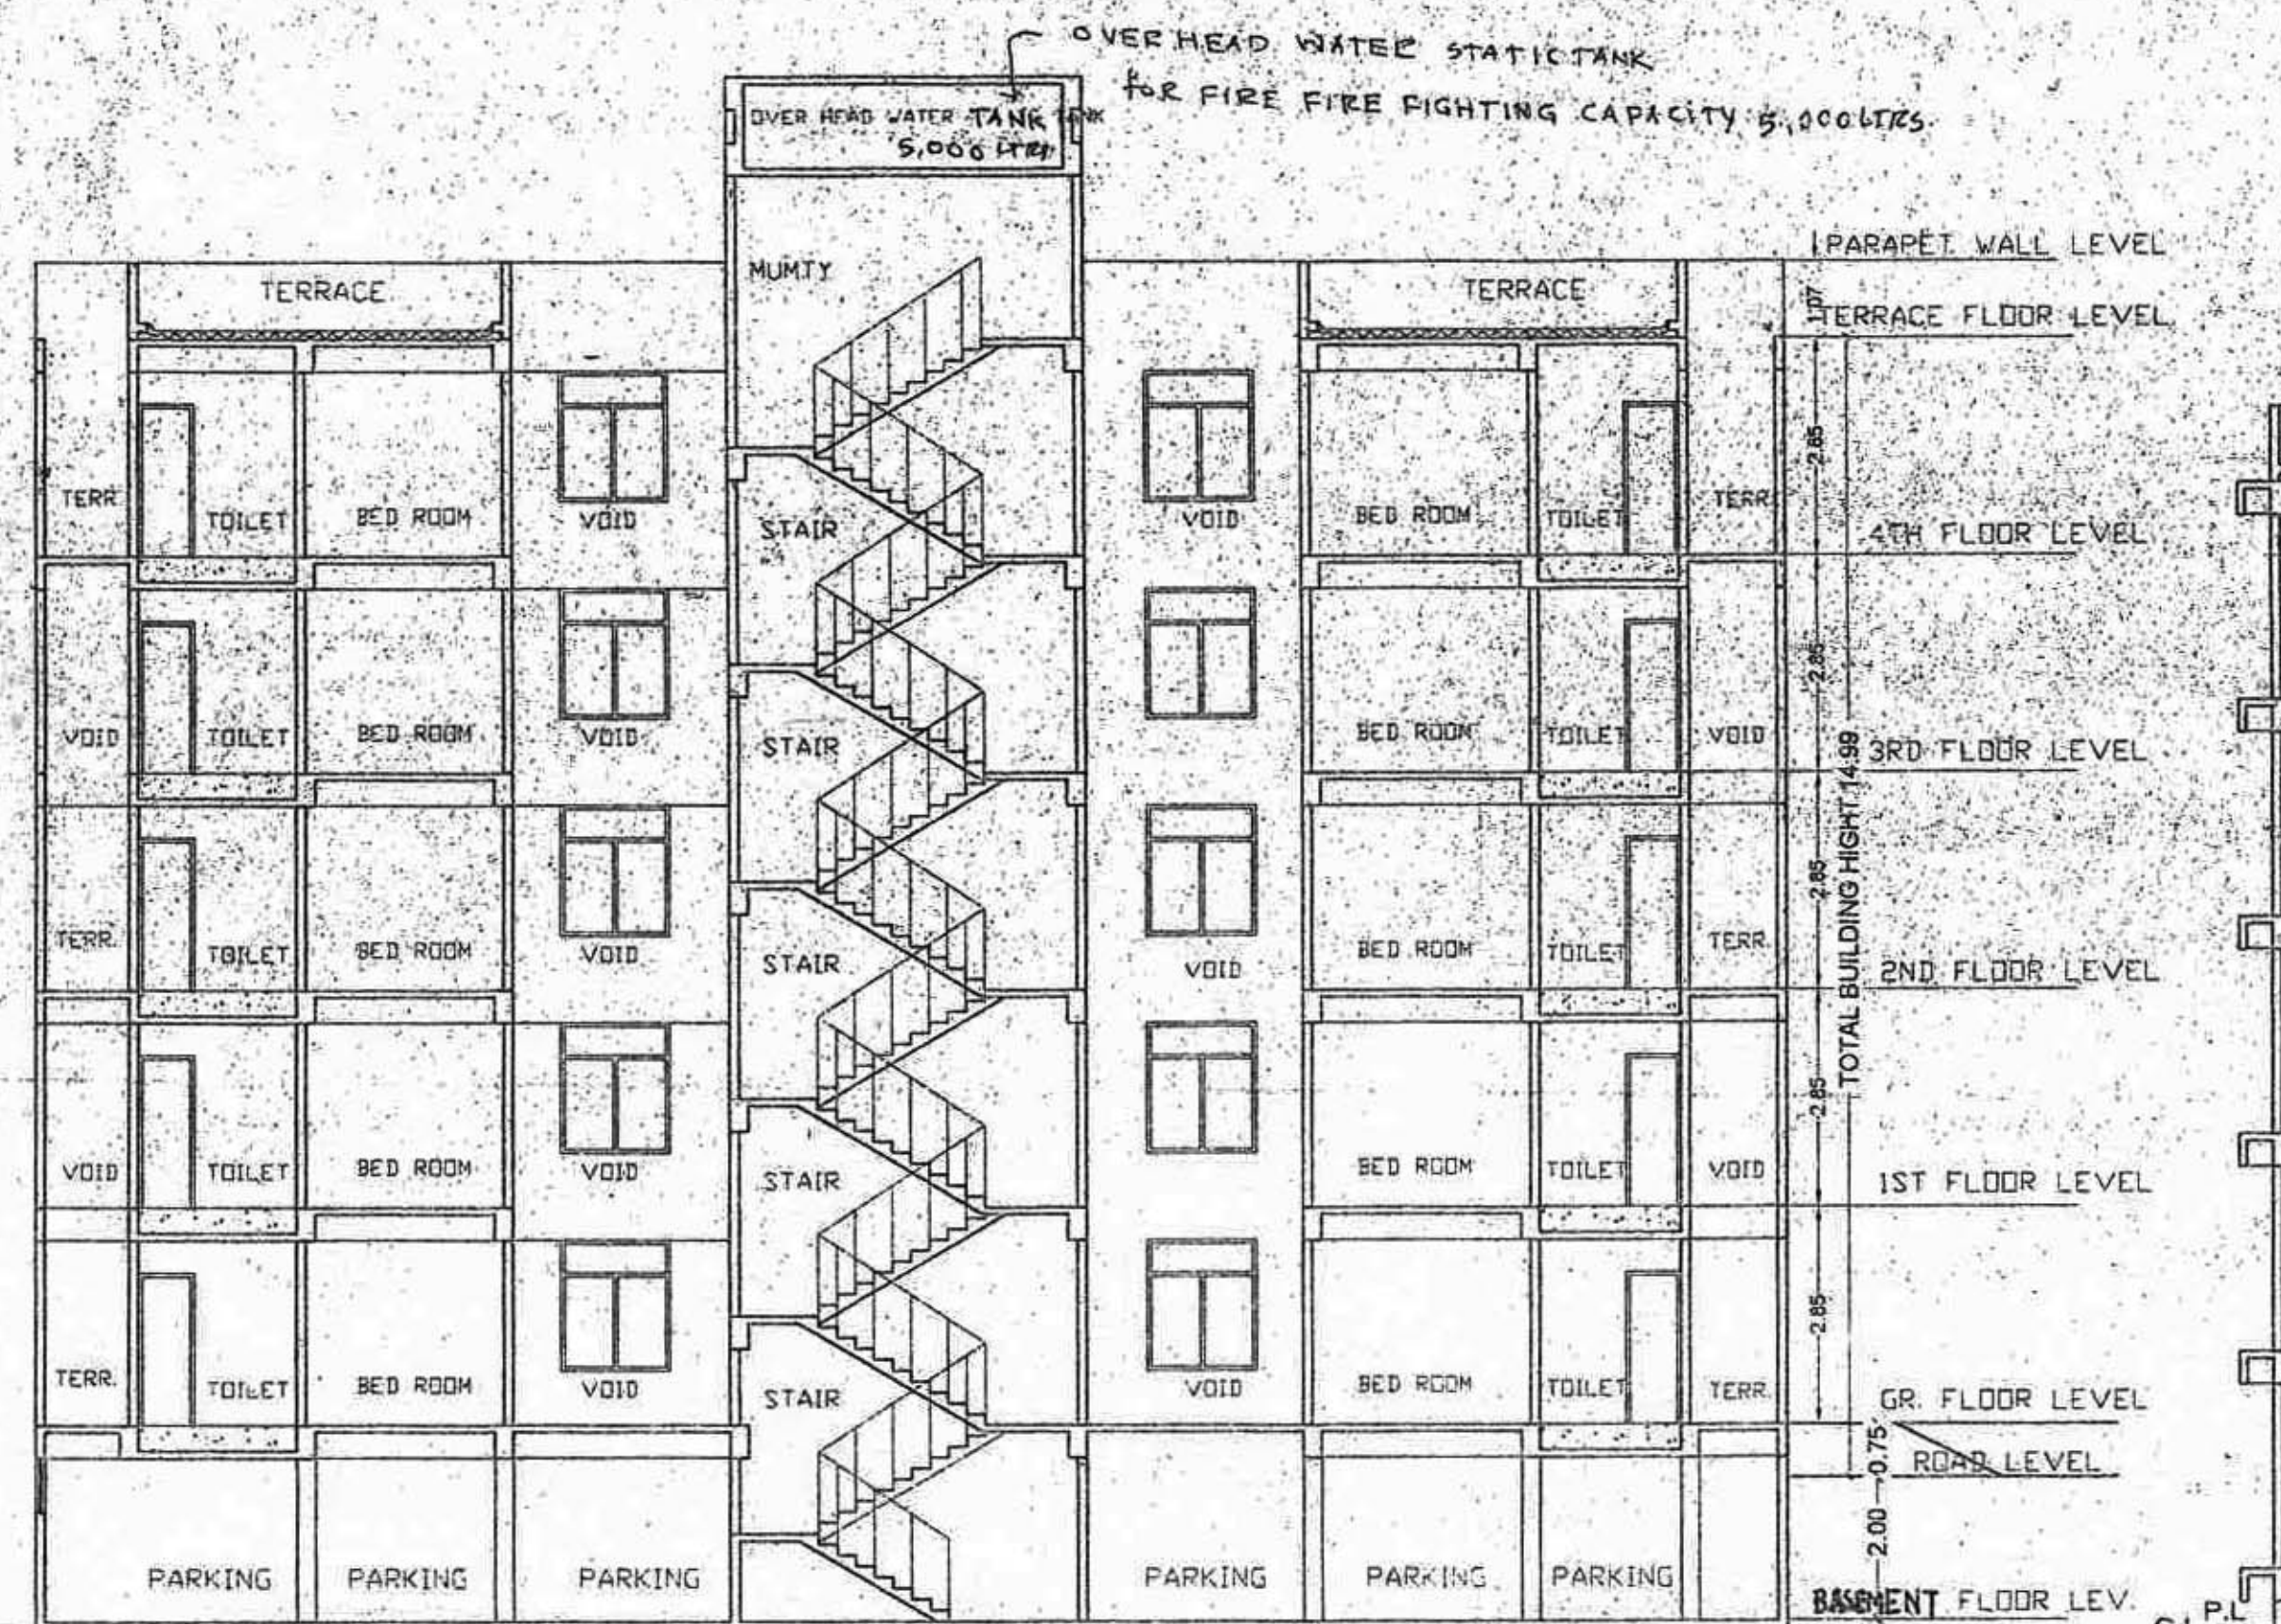

LEGEND FOR FIRE FIGHTING.

- 1) UNDER WATER STATIC TANK
- 2) SEAMESE CONNECTION
- 3) HYDRANT POINT
- 4) HOSE REEL
- 5) FIRE RESISTANCE CHECK DOOR - FD
- 6) EMERGENCY LIGHT
- 7) ILLUMINATED EXIT SIGN
- 8) MANUAL CALL ALARM SYSTEM
- 9) OVER HEAD WATER STATIC TANK

PARKING CALCULATION.

BLOCK - (A)
ONE CAR PARKING SHOULD BE PROVIDED FOR EACH FLAT.
NO OF FLATS = 10
NO OF CAR PARKING REQ. = 10
20 Sqm CAR PARKING AREA REQ. FOR ONE CAR.
AREA REQ. FOR 10 CARS PARKING = 10x20 = 200 Sqm.
provided car parking area = 204.48 sqm

BLOCK - (B)
ONE CAR PARKING SHOULD BE PROVIDED FOR EACH FLAT.
NO OF FLATS = 10
NO OF CAR PARKING REQ. = 10
20 Sqm CAR PARKING AREA REQ. FOR ONE CAR.
AREA REQ. FOR 10 CARS PARKING = 10x20 = 200 Sqm.
provided car parking area = 202.22 sqm

total car parking area block a+ block b = 204.48 + 202.22 = 406.70 sqm

SCHEDULE OF DOORS

TYPE	WIDTH	HEIGHT	SILL	FINISH	REMARKS
D1	1.06	2.29	0.0	2.29	48/ SPECIFICATION
D2	0.99	2.13	0.0	2.13	DO
D3	0.91	2.13	0.0	2.13	DO
D4	0.76	2.13	0.0	2.13	DO
V1	1.83	1.28	0.91	2.29	DO
V2	1.37	1.38	0.91	2.29	DO
V3	1.22	1.38	0.91	2.29	DO
V4	0.86	1.38	0.91	2.29	DO
V5	0.91	1.23	1.06	2.29	DO
V6	0.46	0.92	1.37	2.29	DO

WATER TANK CALCULATION

TOTAL NOS. OF FLAT = 10+10 = 20
ASSUMING 5 PERSONS/FLAT = 100 PERSONS
REQUIREMENT OF SEPTIC WATER FOR 100 PERSONS
@ 135 LTRS./DAY/PERSON = 100x135 = 13500 LTRS.
EXTRA FOR FIRE FIGHTING WATER TANK 10000 LTRS.
= 13500 + 10000 = 23500 LTRS.
SIZE OF OVER HEAD WATER TANK PROVIDED

BLOCK - A = (LxWxH) 4.55x2.44x1.37 = 15.21 CUM = 15210 LTRS.
BLOCK - B = (LxWxH) 3.14x2.13x1.37 = 9.16 CUM = 9160 LTRS.
TOTAL = 24370 LTRS. PROVIDED

DEVELOPER ADDRESS:-
M/S APNA AWAS CONSTRUCTION PVT. LTD.
MANAGING DIRECTOR
SRI JITENDRA KUMAR SINGH
POWER OF ATTORNEY HOLDER
001, SUNDARAM ENCLAVE, KITAB BHAWAN,
NORTH S.K. PURI, PATNA - 800013

Proposed Residential Building
For Sri. Om Prakash Agrawal
S/O - Late - Suraj Bahadur Prasad
Agrawal And Lalita Kumari Singh
Alias - Laila Prasad
S/O - Sri Ramkishan Singh
Grand Father - Dhanraj Prasad
AT - MALUA - MAIN PLAZA - 44/1
TAUZI NO - 15240/15281 - MALUA
3-PLUG NO - 1073/1076 - MALUA - S. PATNA
DIST - PATNA

1:100
1:200
NORTH
02/03

APNA AWAS CONSTRUCTION PVT. LTD.
Managing Director
S. Jitendra Kumar Singh
S. Ramkishan Singh
S. Dhanraj Prasad

SIGN OF DEVELOPER SIGN OF OWNER SIGN OF ARCHITECT/ENG

The Owner/Builder in no case deviate construction from the sanctioned plan. Any Deviation Found during construction or any time the entire structure will be treated as unauthorised and the owner/ builder will be liable for legal action. The owner will keep a copy of sanctioned plan at the site during construction. Sanctioned plan valid for three years only.

Certified Architect (Name) Raman Kumar
C.O.A. Reg. No. - CA/82/6719
ULB (Patna Municipal Corporation)
Empowerment No. - 47/2009
Plan Case No. - 2008/1000/1000 (2) 6-363/11
Date: 24/11/2011
Sanction of Plan according under
Provision of Section 314 of Bihar
Municipal Act 2007

Regd. Architect - Raman Kumar
C.O.A. Reg. No. - CA/82/6719
Empowerment No. - 47/2009
Near Nigam, Patna

